
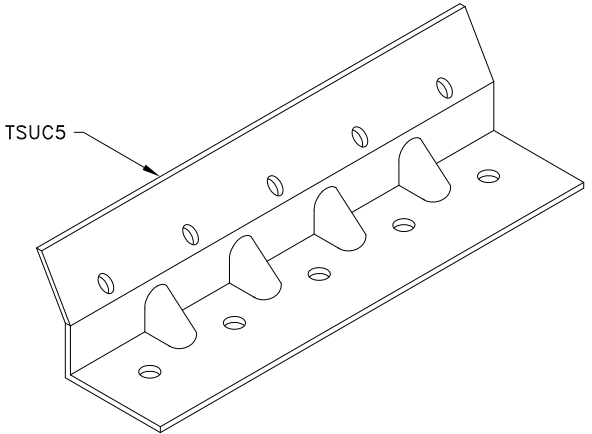


Allowable U lbs (kN) ^A								
Chord	Southern Pine		Douglas Fir-Larch		Spruce-Pine-Fir		Hem-Fir	
	Clip on one face ^B	Clip on both faces	Clip on one face ^B	Clip on both faces	Clip on one face ^B	Clip on both faces	Clip on one face ^B	Clip on both faces
28TSC2.75	400 (1.78)	2050 (9.12)	400 (1.78)	2050 (9.12)	400 (1.78)	400 (1.78)	400 (1.78)	1600 (7.12)
33TSC2.75		2550 (11.34)		2160 (9.61)				
43TSC2.75		2610 (11.61)		2160 (9.61)				
28TSC3.00 or 28TSC4.00	740 (3.29)	2050 (9.12)	740 (3.29)	2050 (9.12)	640 (2.85)	1520 (6.76)	670 (2.98)	1600 (7.12)
33TSC3.00 or 33TSC4.00		2550 (11.34)		2160 (9.61)				
43 & 54TSC3.00, 43, 54, 63 & 97TSC4.00		2610 (11.61)		2160 (9.61)				

Allowable P1 lbs (kN) ^A							
Southern Pine		Douglas Fir-Larch		Spruce-Pine-Fir		Hem-Fir	
Clip on one face	Clip on both faces	Clip on one face	Clip on both faces	Clip on one face	Clip on both faces	Clip on one face	Clip on both faces
1000 (4.45)	2000 (8.90)	930 (4.41)	1860 (8.27)	800 (3.56)	1600 (7.12)	820 (3.65)	1630 (7.25)

Allowable P2 lbs (kN) ^A					
28TSC		33TSC		43, 54, 68 & 97TSC	
Clip on one face	Clip on both faces	Clip on one face	Clip on both faces	Clip on one face	Clip on both faces
520 (2.31)	1050 (4.67)	570 (2.53)	1210 (5.38)	570 (2.53)	1470 (6.54)

A. Allowable loads shown are not in combination.
 B. Uplift connections with a clip on one face require a web above the connection.

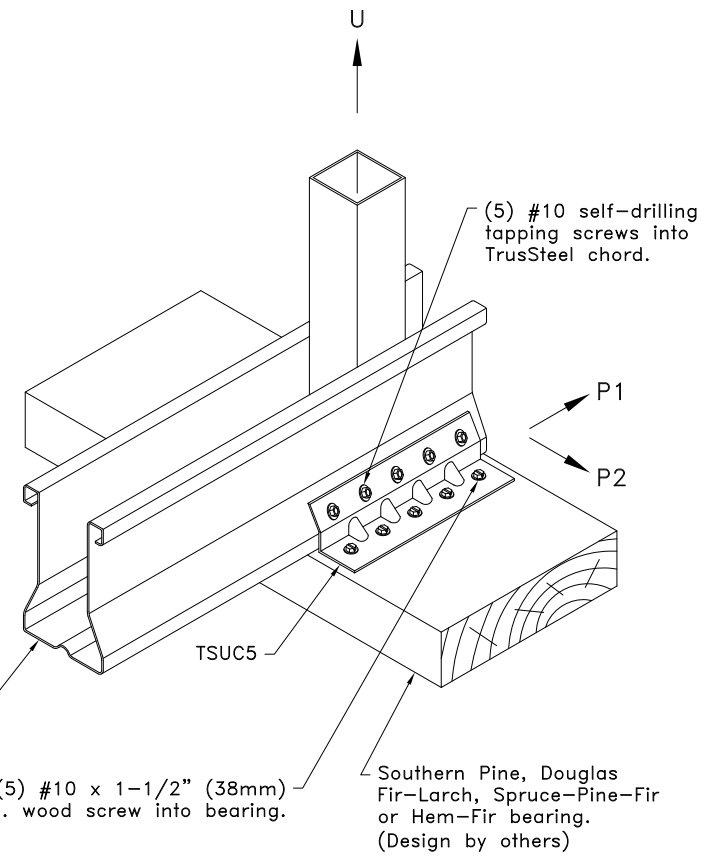

General Notes:

1. 2x6 or larger bearing may be used.
2. If a clip is required on both faces, attach the second clip to the opposite face of the chord as detailed.
3. Multi-ply trusses require a clip on each face. Refer to TrusSteel detail drawing TS023A for ply-to-ply connections for 3-Ply trusses with a clip on each face.
4. Wood screws require a lead hole to be drilled before insertion of screw. Diameter of lead hole to be 9/64" (3.57mm).
5. Allowable wood screw uplift and lateral loads have been increased by 1.6 duration factor for wind and seismic loads.
6. If bearing is pressure treated lumber, reference Steel Framing Alliance bulletin "Pressure Treated Wood and Steel Framing".
7. Allowable fastener values into wood are per ANSI/AWC NDS-2015.
8. Cold-Formed Steel Calculations are per the AISI 2016 "North American Specifications for the Design of Cold-Formed Steel Structural Members" (S100-16).

ALPINE TrusSteel™

www.TrusSteel.com

Florida: 6750 Forum Drive, Suite 305 / Orlando, FL 32821 / (800) 755-6001
 Missouri: 13723 Riverport Drive, Suite 200 / Maryland Heights, MO 63043 / (800) 326-4102

TSUC5 Uplift Attachment To Wood Bearing

Alpine, a division of ITW Building Components Group, Inc. shall not be responsible for any performance failure in a connection due to a deviation from this detail. Any variation from this detail shall be approved in advance by Alpine, a division of ITW Building Components Group, Inc.

Standard Detail:
 TS033

Date:
 10/11/18

TrusSteel Detail Category:
 Truss-To-Bearing: Wood

Standard Detail:
 TS033

Date:
 10/11/18

TrusSteel Detail Category:
 Truss-To-Bearing: Wood