
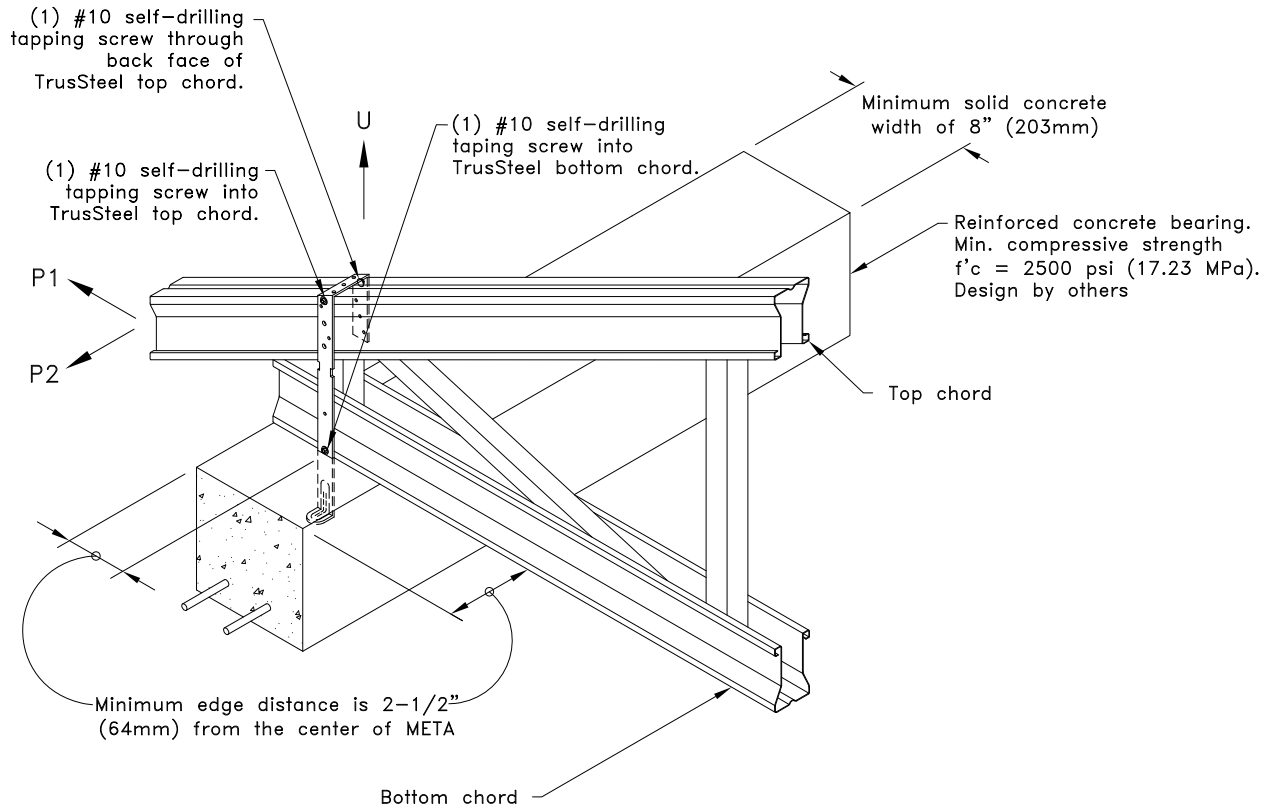


Contact a TrusSteel engineer if the approved truss drawing has been analyzed with a bearing under the bottom chord. Resisting uplift at the top chord of the truss changes the truss analysis.

| Allowable U lbs (kN) ^A | | |
|---|------------------|--------------------|
| Chord | META on One Face | META on Both Faces |
| 28TSC2.75 | 550 (2.45) | 1210 (5.38) |
| 33TSC2.75 | | 1530 (6.81) |
| 43TSC2.75 | | 1800 (8.00) |
| 28TSC3.00 or 28TSC4.00 | 590 (2.62) | 1180 (5.25) |
| 33TSC3.00 or 33TSC4.00 | 760 (3.38) | 1530 (6.81) |
| 43TSC3.00 or 43TSC4.00 | 900 (4.00) | 1800 (8.00) |
| 54TSC3.00 or 54TSC4.00 | | |
| 68TSC4.00 | | |
| 97TSC4.00 | | |
| Allowable P1 and P2 lbs (kN) ^A | | |
| P1/P2 | META on One Face | META on Both Faces |
| P1 | 85 (0.38) | 170 (0.76) |
| P2 | 65 (0.29) | 130 (0.58) |

A. Allowable loads shown are not in combination.

| META | "L" in. (mm) |
|--------|--------------|
| META16 | 12 (305) |
| META18 | 14 (356) |
| META20 | 16 (406) |
| META22 | 18 (457) |
| META24 | 20 (508) |

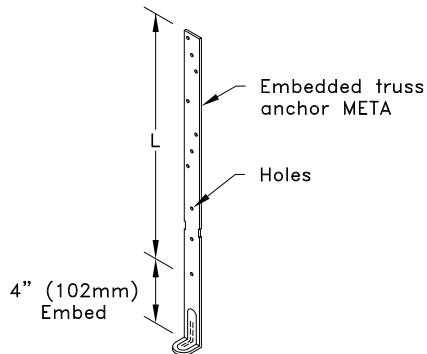

General Notes:

1. If an META is required on both faces, attach the second META to the opposite face of the chord as detailed.
2. 2-Ply trusses require a strap on each face. For connection to 3-Ply trusses contact a TrusSteel engineer.
3. Truss shall be designed with at least one vertical web over the bearing.
4. See detail above for required number of screws and placement.
5. META shall be installed so it wraps over the top of the truss and returns down the back side of the top chord as shown in detail above.
6. Allowable loads shown are for use with normal weight concrete.
7. Cold-Formed Steel Calculations are per the AISI 2016 "North American Specifications for the Design of Cold-Formed Steel Structural Members" (S100-16).
8. It is permissible to substitute an equal alternative for the Simpson Strong-Tie hardware specified on this detail.



www.TrusSteel.com

Florida: 6750 Forum Drive, Suite 305 / Orlando, FL 32821 / (800) 755-6001
 Missouri: 13723 Riverport Drive, Suite 200 / Maryland Heights, MO 63043 / (800) 326-4102

Simpson META (or equal) Uplift Attachment Over Top Of Truss Into Concrete Bearing

Alpine, a division of ITW Building Components Group, Inc. shall not be responsible for any performance failure in a connection due to a deviation from this detail. Any variation from this detail shall be approved in advance by Alpine, a division of ITW Building Components Group, Inc.

Standard Detail:

TS035

Date:

10/11/18

TrusSteel Detail Category:

Truss-To-Bearing: Concrete